

INVITATION FOR BIDS CCK-2722-23 Gatton Business and Economics Suites Renovation Room 144 ADDENDUM # 3 5/26/2023

IMPORTANT: BID AND ADDENDUM MUST BE RECEIVED BY 5/31/2023 @ 3:00 P.M. LEXINGTON, KY TIME

Bidder must acknowledge receipt of this and any addendum as stated in the Invitation for Bids.

Please refer to and incorporate within the offer the attached revised drawing, E1.1.

OFFICIAL APPROVAL UNIVERSITY OF KENTUCKY

Patricia Pflug

Contracting Officer / (859) 257-9102


SIGNATURE


Typed or Printed Name

University of Kentucky Purchasing Division 322 Peterson Service Building Lexington, KY 40506-0005


	REVIS	sions
#	DATE	DESCRIPTION
1	05/25/2023	ADDENDUM #1


NOTE:

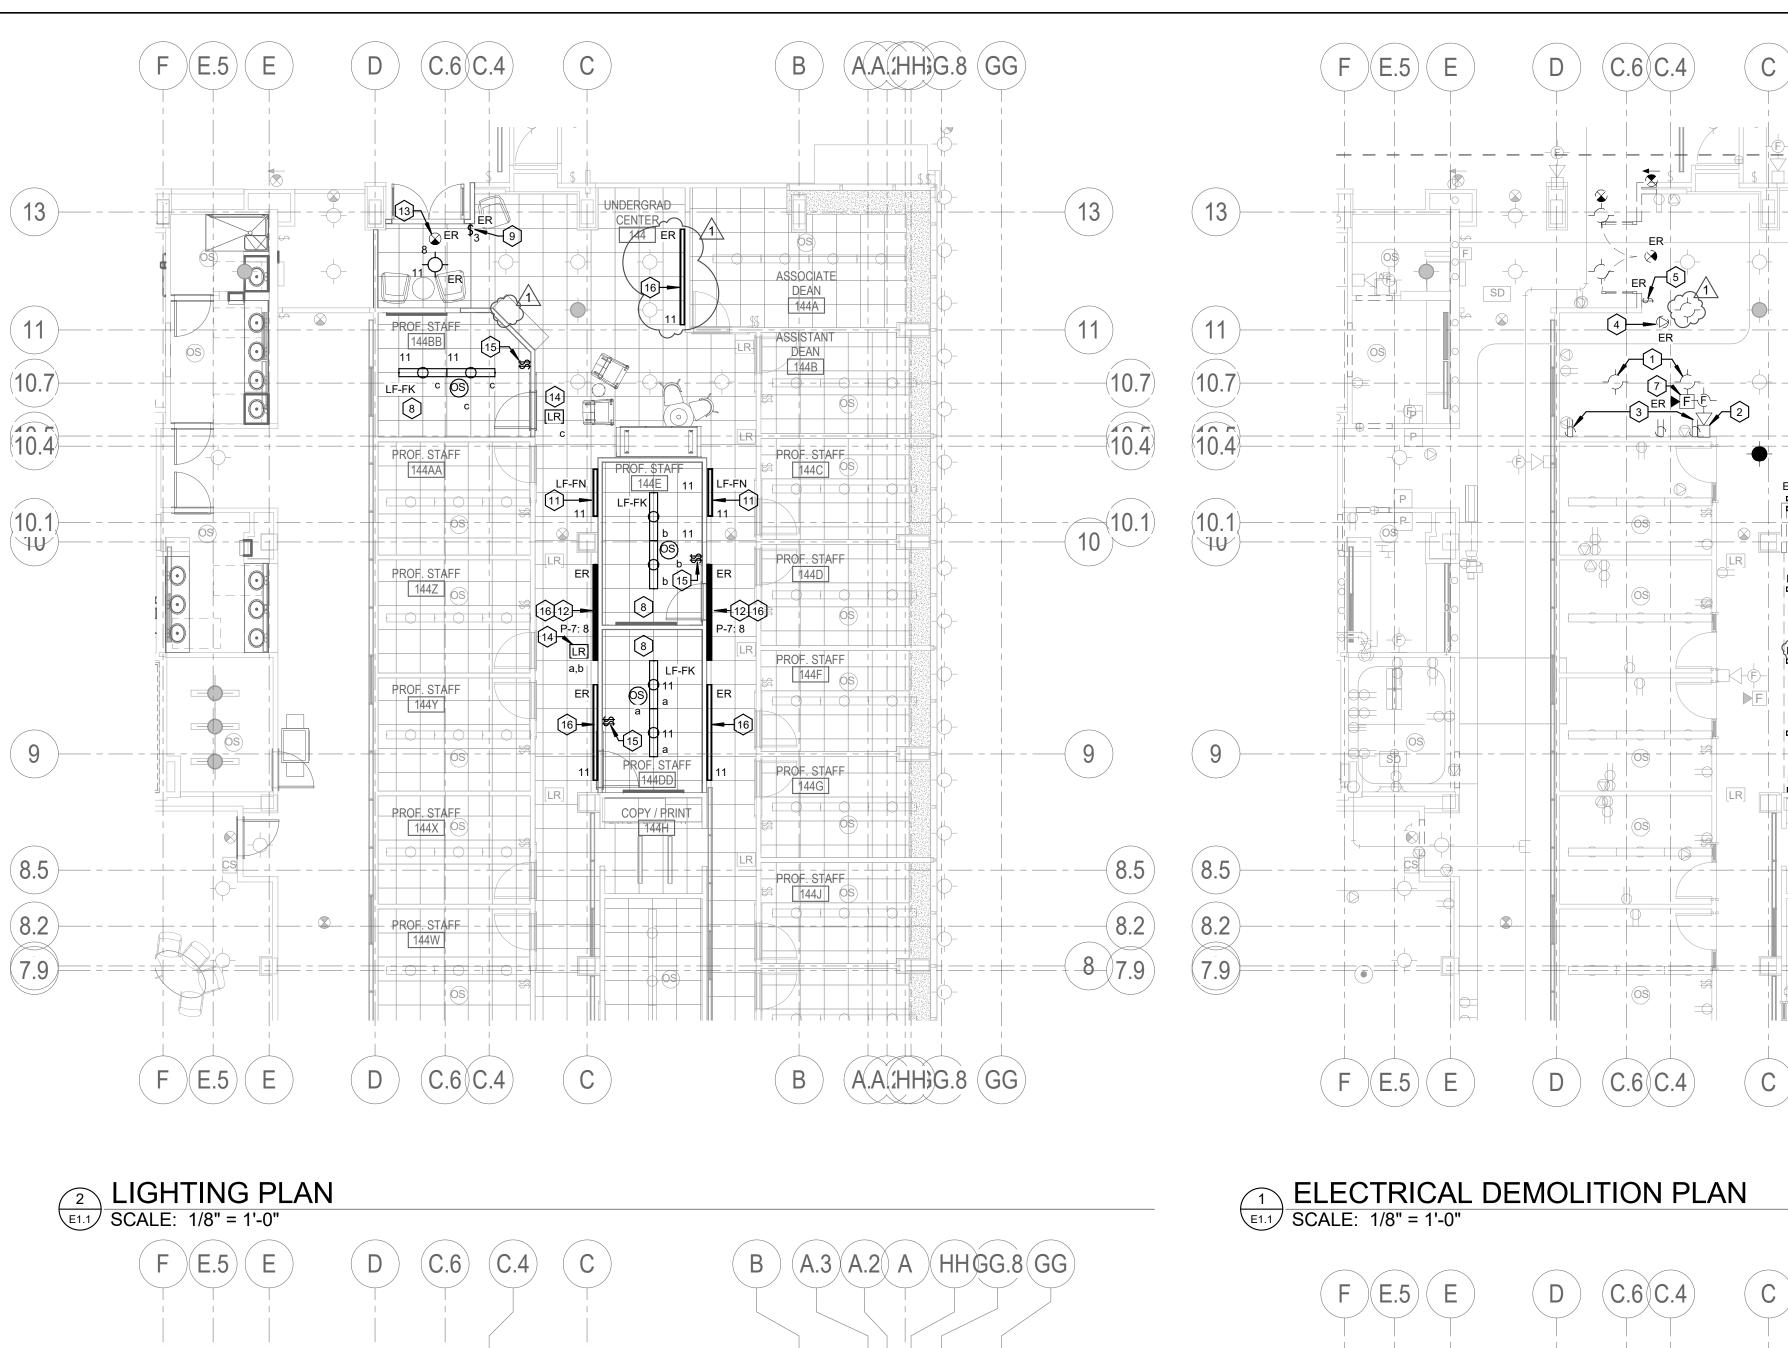

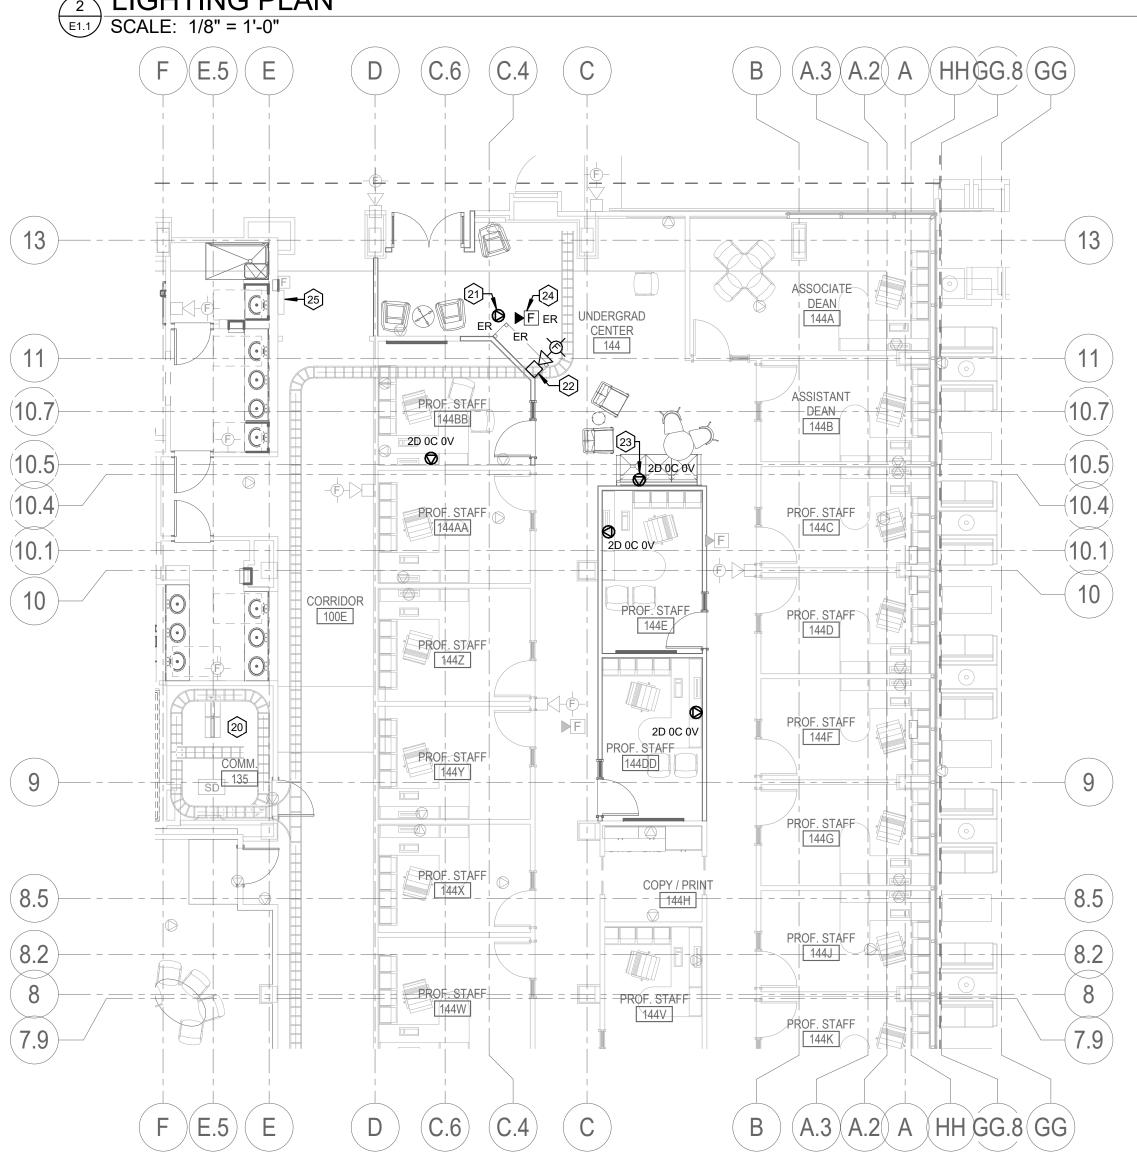


4 LOW VOLTAGE PLAN E1.1 SCALE: 1/8" = 1'-0"

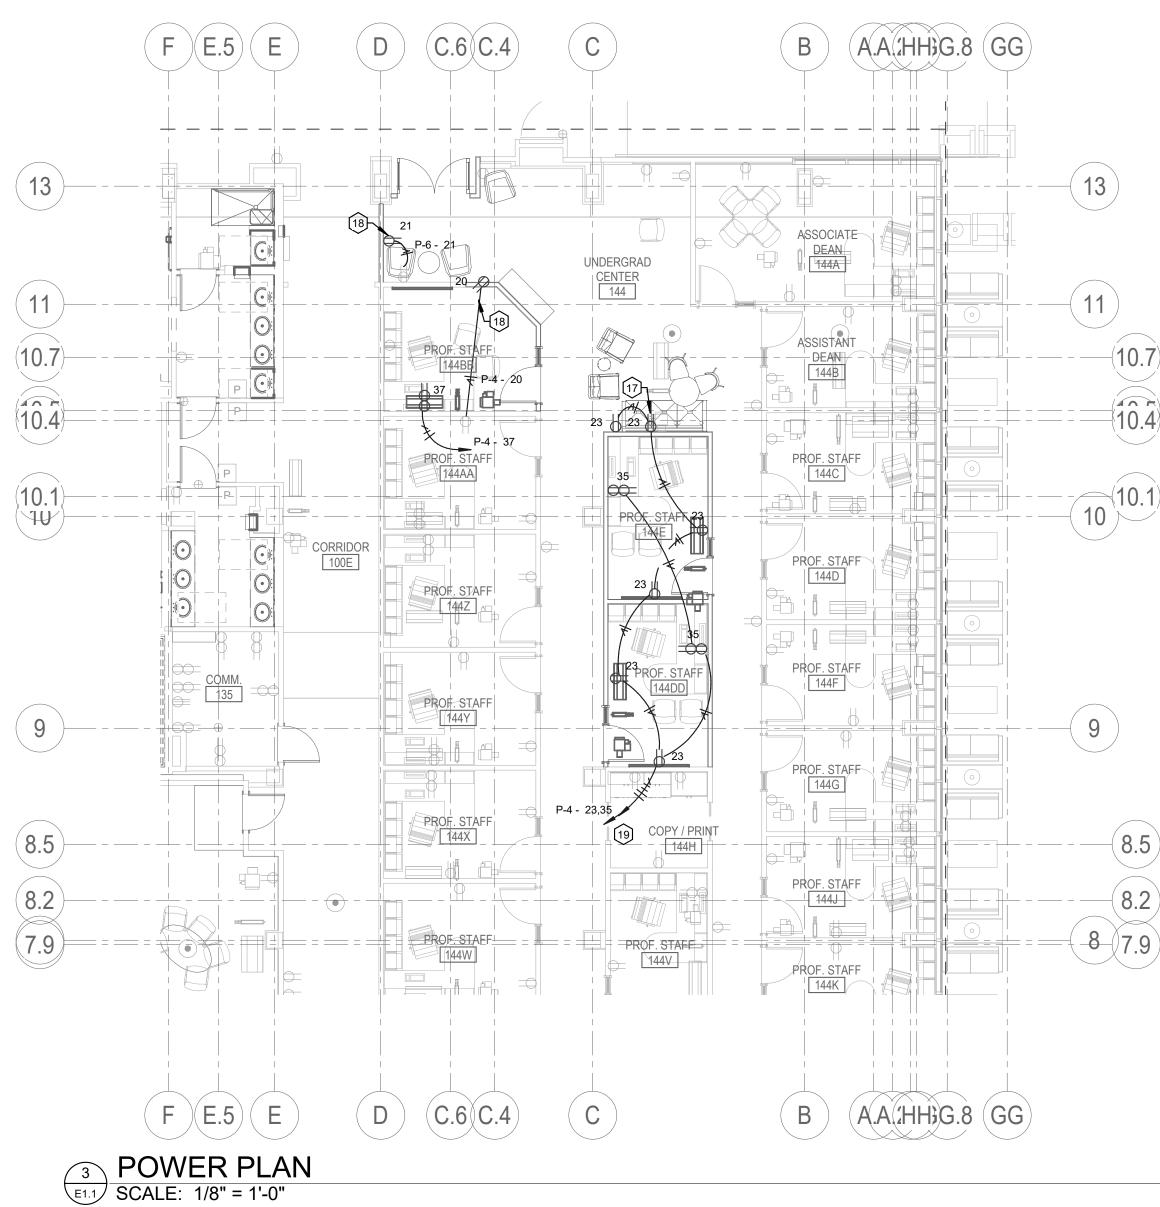

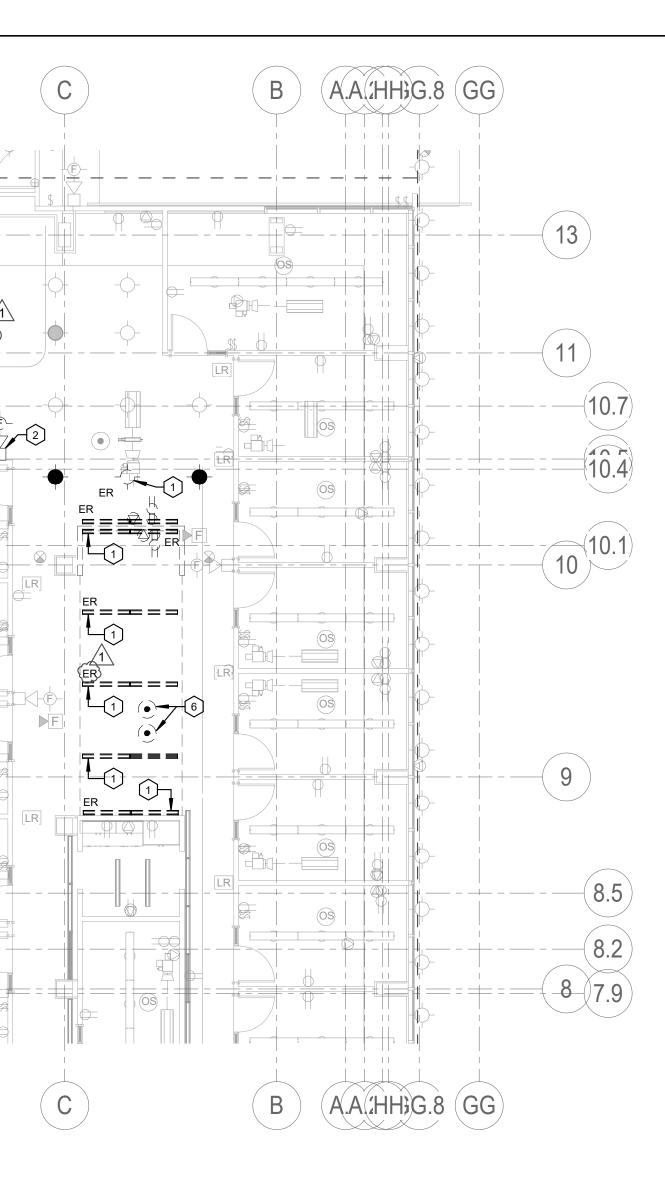

\bigcirc	CODED NOTES:
1	DISCONNECT AND REMOVE EXISTING LUMINAIRE. REMOVE EXISTING CONTROL CA CONDUIT BACK TO SOURCE. REMOVE EXISTING LINE VOLTAGE WIRING AND COND NEAREST JUNCTION BOX UNAFFECTED BY DEMOLITION. SALVAGE AND STORE LUI RE-USE.
2	DISCONNECT AND REMOVE EXISTING FIRE ALARM DEVICE AND SALVAGE FOR REIL NEW LOCATION. REMOVE CABLING AND CONDUIT BACK TO NEAREST JUNCTION BO DEMOLITION.
3	DISCONNECT AND REMOVE ALL ELECTRICAL AND LOW VOLTAGE DEVICES IN EXIS REMOVE EXISTING DEVICE BACKBOXES AND PATCH AND PAINT EXISTING WALL TO WALL FINISH.
4	RELOCATE EXISTING WAP AND DATA OUTLET TO NEW LOCATION . REFER TO LOW FOR NEW LOCATION.
5	EXISTING LIGHTING CONTROL DEVICE TO BE RELOCATED. DISCONNECT AND REM CONDUIT BACK TO NEAREST JUNCTION BOX.
6	EXISTING FLOORBOX TO BE ABANDONED. DISCONNECT AND REMOVE ALL DEVICE FLOORBOX MOUNTED DEVICES AND REMOVE CABLING BACK TO SOURCE. PROVID COVER FOR ABAONDONED JUNCTION BOX.
7	EXISTING FIRE ALARM SPEAKER TO BE RELOCATED. DISCONNECT AND REMOVE A RE-INSTALLATION AT NEW LOCATION. MODIFY EXISTING CABLING AS REQUIRED TO SERVICE TO OTHER SPEAKERS IN AREA.
8	PROVIDE TWO LEVEL LIGHTING IN THIS ROOM. CONNECT NEW FIXTURES TO EXIST CIRCUIT SERVING THE SPACE. PROVIDE LUTRON DUAL TECHNOLOGY CDT SERIES SENSOR TO MATCH EXISTING DEVICES. PROVIDE ISOLATED RELAY FOR CONNECT CONTROLS.
9	RELOCATE EXISTING LIGHTING CONTROL STATION IN NEW LOCATION. PROVIDE NE BACKBOX IN EXISTING DRYWALL WALL. RECONNECT RELOCATED SWITCH EXISTIN CIRCUIT. EXTEND CONDUIT AND CABLING AS REQUIRED.
11	INSTALL OWNER FURNISHED FIXTURE IN EXISTING CEILING. PROVIDE PERIMETER AND HARDWARE AS REQUIRED. CONNECT FIXTURES TO EXISTING CORRIDOR LIGH CONTROLS. RELAMP ALL RELOCATED FIXTUES WITH LAMPS TO MATCH EXISTING F STANDARD.
12	CONNECT FIXTURE TO EXISTING EMERGENCY LIGHTING CIRCUIT SERVING THE ARCONDUIT AND WIRING AS REQUIRED.
13	CONNECT RELOCATED EXIT SIGN TO EXISTING EXIT SIGN CIRCUIT SERVING THE A
14	PROVIDE NEW LUTRON QSN 0-10V ENERGI SAVR NODE IN EXISTING ACCESSIBLE C CABLING AS REQUIRED TO CONNECT TO EXISTING QS CONTROL LINK.
15	PROVIDE NEW LUTRON WIRED 2-BUTTON 0-10V PICO WALLSTATION TO MATCH EXILIGHTING CONTROL TO ALLOW FOR REDUCTION OF LIGHT TO 50% MAXIMUM OUTF WIRING FROM WALL STATION TO QSN RELAY MODULE.
16	REINSTALL EXISTING FIXTURES IN NEW LOCATION AS SHOWN. PROVIDE NEW PER KITS AS REQUIRED. PROVIDE REPLACEMENT LENSES TO REPLACE EXISTING DAM
17	PROVIDE RECEPTACLE INSTALLED AT ELEVATION OF WALL MOUNTED MONITOR. C ARCHITECTURAL DRAWINGS PRIOR TO ROUGH-IN.
18	WIRE NEW RECEPTACLE TO EXISTING CIRCUIT SERVING THE AREA. EXTEND CONE AS REQUIRED.
19	WIRE NEW RECEPTACLES TO EXISTING CIRCUITS MADE AVAILABLE DURING DEMC CONDUIT AND CABLING AS REQUIRED.
20	PROVIDE NEW CAT6 CABLING ROUTED IN EXISTING CABLE TRAY TO EXISTING IDF THE AREA. TERMINATE CABLE IN EXISTING PATCH PANEL. LABEL BOTH ENDS OF C OWNER STANDARDS.
21	RE-INSTALL EXISTING DATA OUTLET FOR RELOCATED WAP.
22	RE-INSTALL FIRE ALARM COMBINATION STROBE IN NEW LOCATION. EXTEND COND REQUIRED.
23	PROVIDE NEW DATA RECEPTACLE INSTALLED AT ELEVATION OF WALL MOUNTED I

- COORDINATE WITH ARCHITECTURAL DRAWINGS PRIOR TO ROUGH-IN.
- 24 RE-INSTALL EXISTING FIRE ALARM SPEAKER IN NEW LOCATION SHOWN. EXTEND CONDUIT AND CABLING AS REQUIRED.
- 25 EXISTING FIRE ALARM CONTROL PANEL.
- 26 LOCATION OF EXISTING PANELBOARDS 'P-2' AND 'P-4' AND EMERGENCY LIGHTING PANEL 'P-7'.

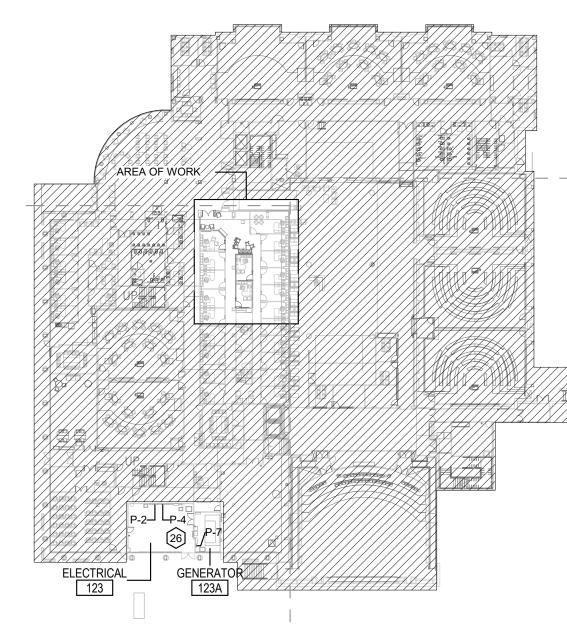

LEVEL 01 OVERALL PLAN SCALE: 1" = 50'-0"

